Capacitor Temperature Monitor With STC3000.

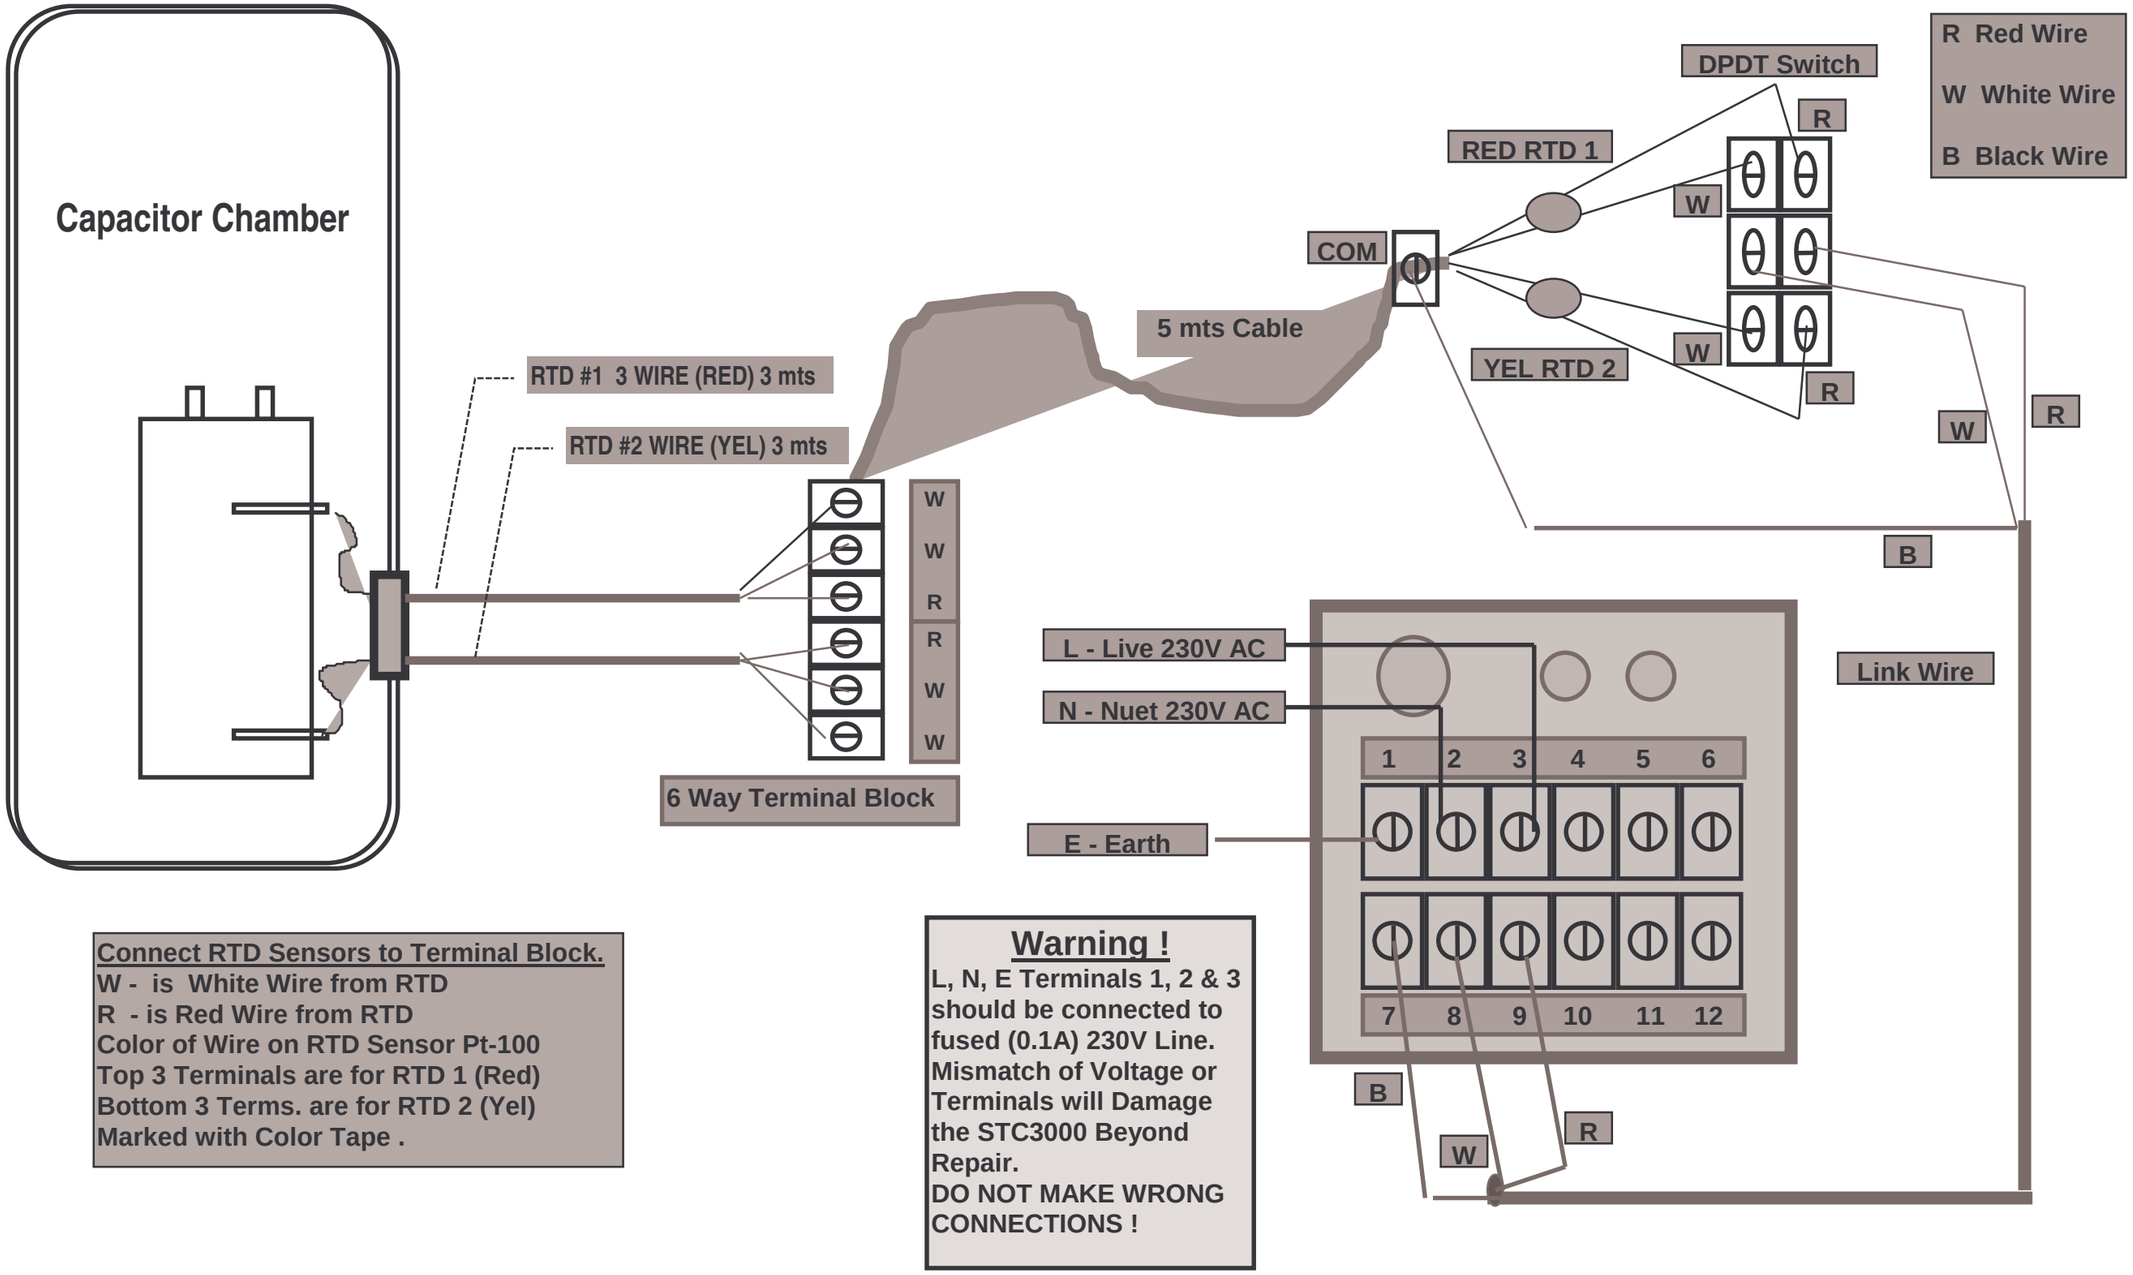

Connect RTD Sensors to Terminal Block.
W - is White Wire from RTD
R - is Red Wire from RTD
Color of Wire on RTD Sensor Pt-100
Top 3 Terminals are for RTD 1 (Red)
Bottom 3 Terms. are for RTD 2 (Yel)
Marked with Color Tape .

Warning !
L, N, E Terminals 1, 2 & 3 should be connected to fused (0.1A) 230V Line. Mismatch of Voltage or Terminals will Damage the STC3000 Beyond Repair.
DO NOT MAKE WRONG CONNECTIONS !

Application Note Given is for enhancing engineers information and is not a tested or working idea. The Correctness of above is not implied by our Company or Engineers.